



DŴR CYMRU WELSH WATER

**Sewers for Adoption 7th Edition
Sewage Pumping Station Addendum
February 2013**

Document ID: MS166 version 2

Contents

| | | |
|---|---|----|
| 1 | Purpose | 5 |
| 2 | Procurement..... | 6 |
| 3 | Hazardous Areas Rating | 6 |
| 4 | Designer’s Responsibilities | 7 |
| 5 | Part D - Pumping Stations..... | 7 |
| | D2 Definitions..... | 7 |
| | D4.1 Location..... | 7 |
| | D4.3 Site Layout | 7 |
| | D4.4 Kiosk positioning | 8 |
| | D4.5 Storage..... | 8 |
| | D4.6 Hydraulic design of pumping stations | 8 |
| | D5.2 Reliability..... | 8 |
| | D5.3 Hydraulic Design | 8 |
| | D6.1 General..... | 9 |
| | D6.2 Hazardous areas | 9 |
| | D6.3 Wet well - general..... | 9 |
| | D6.4 Wet well – structural design | 9 |
| | D6.5 Valve chamber | 10 |
| | D6.6 Flow metering..... | 10 |
| | D6.7 Access into wet well, valve chambers and flow meter chambers | 10 |
| | D6.11 Kiosk construction | 11 |
| 6 | Part F – Mechanical and Electrical Specification for Small Pumping Stations | 11 |
| | F1.1 Hazardous area appliances | 11 |
| | F1.2 Operation and maintenance documentation | 12 |
| | F2.1 Introduction..... | 12 |
| | F2.3.6 Impellers..... | 12 |
| | F2.3.14.1 General..... | 12 |
| | F2.3.14.2 Lifting Chain Location System..... | 12 |
| | F2.3.14.3 Lifting Chains..... | 12 |
| | F2.3.16 Pump Unit Protection Sensors..... | 12 |
| | F3 ELECTRICAL | 12 |
| | F3.2.1 General..... | 13 |
| | F3.3.1 General | 13 |
| | F3.3.4 Earthing and Bonding | 13 |
| | F.3.3.4.1 General | 13 |
| | F3.3.5 Cabling and Wiring..... | 13 |

| | |
|---|----|
| F.3.3.5.1 General | 13 |
| F.3.3.5.2 Installation | 14 |
| F.3.3.5.3 Identification of Wiring..... | 14 |
| F.3.3.5.4 Termination of Wiring..... | 14 |
| F.3.3.5.4.1 General | 14 |
| F3.3.6 Indicator Lamps, Push-Buttons and Selector Switches..... | 15 |
| F3.3.7 Connection for a Mobile Generator..... | 16 |
| F3.3.8 Abnormal Operation | 16 |
| F.3.3.8.2 Pump unit Failure (Initiated by Hard-Wired Pump unit Protection Systems)..... | 16 |
| F.3.3.8.4 Back-Up Control Mode | 17 |
| F3.3.9 Telemetry Signals | 17 |
| F.3.3.11.1 General | 20 |
| F.3.3.11.2 Incomer Compartment | 20 |
| F.3.3.11.3 Control Circuit Supplies | 20 |
| F.3.3.11.4 Motor Starter Compartments | 20 |
| F.3.3.11.5 Common Control Compartment (CCC) | 20 |
| F.3.3.12.2 Assembly Equipment..... | 20 |
| F.3.3.12.3 Incomer | 21 |
| F.3.3.12.4 Control Circuit Supplies | 21 |
| F.3.3.12.5 Motor Starters | 21 |
| F.3.3.12.6 Common Control Section..... | 21 |
| F.3.4.1.5 Junction Boxes..... | 21 |
| F3.4.3 Cables | 21 |
| F3.4.4 Installation of Cables..... | 23 |
| F.3.4.5.1 Glanding..... | 23 |
| F3.5.1 Flowmeter Specification | 23 |
| F3.6 Telemetry outstation..... | 23 |

1 Purpose

Sewers for Adoption 7th Edition does not extend to specific Company requirements where a developer wishes to build a pumping station. This Addendum sets out those requirements that are specific to Dwr Cymru-Welsh Water (DCWW) where a developer wishes to design and construct a pumping station for inclusion within an adoption agreement. The clauses within the document are referenced to the Sewers for Adoption 7th edition and follow on from the clauses detailed within the main document.

It is intended that this Addendum in conjunction with Sewers for Adoption 7th Edition will provide specific guidance for the design and general specification, of sewerage elements involved when making an application to DCWW.

This Addendum does not remove the need for early engagement and constructive discussions between DCWW and developers at appropriate stages or where site specific factors need to be addressed in advance of making an application.

For discussions where a pumping station is to form part of an adoption agreement Developer's should contact the 'Developer Services Team at the following address

Dŵr Cymru Welsh Water

Developer Services
Linea
Fortran Road
St Mellons
Cardiff
CF3 0LT

Telephone: 0800 917 2652

For configuration of the Remote Telemetry Unit contact:-

Dŵr Cymru Welsh Water

Telemetry Operational Services
Pentwyn Road
Nelson
Treharris
Mid Glamorgan CF46 6LY

Tel: 01443 452300
Fax: 01443 452323

Requests for specific products & technical specifications to be accepted by Dwr Cymru Welsh Water should be addressed to:-

Dŵr Cymru Welsh Water

Cost and Engineering Department
Asset Strategy & Planning
Pentwyn Road
Nelson
Treharris
Mid Glamorgan CF46 6LY

Tel: 01443 452300
Fax: 01443 452323

Information on DCWW's Current framework suppliers Can be obtained from:-

Dŵr Cymru Welsh Water
M&E Commodities Manager
Procurement Department
Pentwyn Road
Nelson
Treharris
Mid Glamorgan CF46 6LY

Tel: 01443 452300
Fax: 01443 452323

The clause numbers below refer to those in Sewers for Adoption; these clauses are supplementary and follow on from the clauses listed in the main document except where the sub clause number is prefixed by an '(R)', in which case it is a replacement clause.

2 Procurement

The equipment should be selected from preferred suppliers identified within this Addendum and associated Standard Drawings in accordance with the relevant Dwr Cymru -Welsh Water (DCWW) Framework Agreements. Where the design solution requires the procurement of equipment that can only be obtained from a non-framework supplier, the Developer shall specify the requirements as part of the Particular Design Specification for the scheme or contract.

The applicable product areas detailed within this Addendum and associated Standard Drawings are:

- Pumps
- Low voltage switchgear and control gear assembly (Electrical Control Panels)
- Instrumentation
- Telemetry

Where a product is available from more than one Framework Supplier, or there are no relevant Framework Agreements, the final selection for technically compliant submissions shall be made with reference to DCWW Procurement Guidelines (available on request to the DCWW Procurement Dept), Whole Life Costs and sustainability analysis.

3 Hazardous Areas Rating

All equipment installed in wet, or dry wells, shall be rated according to the zone classification of the area in which they are to be installed.

Guidance on how to comply with the DSEAR Regulations for zone classification can be found in the current versions of the following DCWW documents which are available on request to the DCWW Cost & Engineering team:

- AM_L_PR1_005 – DCWW procedures for Dangerous Substances and Explosive Atmospheres Regulations 2002 (DSEAR);
- DCWW PEXA Handbook
- DCWW Explosion Protection Document

4 Designer's Responsibilities

The designer aspects of the mechanical and electrical design of the station take into account the requirements, stipulations and recommendations contained in UK safety legislation, including (but not limited to) the following:

- Health & Safety at Work Act (HASAW);
- Approved Codes of Practice (ACOPS);
- Working at Height (WAH);
- Provision & Use of Work Equipment Regulations (PUWER);
- Lifting Operations & Lifting Equipment Regulations (LOLER);
- Construction Design & Management Regulations (CDM).

5 Part D - Pumping Stations

D2 Definitions

2(R). The classifications of pumping station shall be determined by the pumped flow rate or number of properties served as listed below:

Type 1: Having a pump flow rate of between 1.5 l/s and 3.8 l/s. (typically 5 dwellings or less);

Type 2: Having a pump flow rate of between 3.8 l/s and 6 l/s. (typically six to twenty dwellings)

Type 3: Having a pump flow rate of between 6 l/s and 14 l/s. (typically twenty to 300 dwellings) but with pumps rated no more than 30kW

Type 4: Having at least one pump rated more than 30 kW and having a pumped flows rate greater than 14 l/s. These are outside the parameters of Sewers for Adoption 7th Edition and guidance should be sought from the Developers Services Team if a higher kW rated pump-set is proposed.

D4.1 Location

2(R). The pumping station should not be located where it might be susceptible to flooding at a frequency of more than 1 in 30 years. All electrical control equipment should be sited above the 1 in 200 year flood level where practicable.

D4.3 Site Layout

5. Gates and fencing are required around the compound. For details please contact Developer Services Team for security classification of assets.

The level of security classification will determine the type of Security Fence required and/or which type of secure enclosure/kiosk may be necessary.

The developer must carry out a site based and desktop risk assessment to determine any fencing requirements from a Health and Safety perspective.

The higher grade of fencing requirement as a result of the above procedures will be the minimum required for the site.

15. Flush davit sockets must be equipped with a captive/tethered cover designed to limit the ingress of debris.

16. Typical Layouts for Type1 & 2 and Type 3 pumping station are shown on DCWW standard drawing no: SDM4001/004 & SDM4001/005.

D4.4 Kiosk positioning

1. b(R) there is at least 750mm wide permeable hard standing in front of the kiosk.

D4.5 Storage

2. c) DCWW will only consider adopting storage which utilises sewers and manholes in exceptional circumstances.

5. Peak design flow is 6 x Dry Weather Flow (dwf).

6. An emergency overflow is normally required on all pumping stations, however if this is not attainable 50% additional storage over and above the design flow for the development is required.

D4.6 Hydraulic design of pumping stations

3(R). The Type 1 & 2 pumping station shall use level control by float switch due to the dimensional and congested design of the wet well but where practicable all Type 3 station should be provided with an ultrasonic level control system. Four level set points should be set in the wet well. These should be a 'snore' level, a pump unit stop level, a duty pump unit start level and a HH level. These levels should be selected to ensure that:

- a) the pump units operate safely and effectively in accordance with the pump unit manufacturer's instructions (i.e., the pump units do not exhibit damaging cavitations, vibration or air-locking or create damaging surface vortices);
- b) If the wet well is in a hazardous area, the pump units do not contravene any DSEAR requirements, the pump unit manufacturer should be consulted to this end;
- c) The number of pump unit starts per hour is not more than fifteen;
- d) The pump unit run time is not less than 60 seconds;
- e) The combined sewage retention time in the wet well and the rising main is not more than 6 hours (to prevent septicity occurring);
- f) The stop level is as low as possible, without compromising the effective operation of the pump unit. This should be the level used for automatic control and should be set at a point where the pump unit has adequate submergence (to prevent air ingestion due to vortices) and adequate NPSH(a) to suppress damaging cavitation;
- g) the high level backup float switch in the wet well is not routinely activated (i.e., the standby pump unit start level should be a minimum of 100 mm below the high level backup float switch in the wet well); and
- h) The standby pump unit start level is a minimum of 150 mm above the duty pump unit start level.

D5.2 Reliability

2. In this case it may be possible to use 50 mm nominal bore rising mains although consideration should be given to the maximum length of main and the delivery pressure.

D5.3 Hydraulic Design

3. a) or to use a water replenishing system to provide additional flow during low flow conditions. For potable water supplies this will require approval from the local water networks distribution team.

4. In certain circumstances where it is not practicable to place a separate manhole upstream of an existing manhole the Undertaker may agree that the end of the rising main can discharge directly into an existing manhole on the public sewer.

D6.1 General

1(R). The pumping station should be designed to operate in the following modes:

- a) Automatic mode – in this mode of operation the control system operates the pumping station automatically, without need for manual intervention;
- b) manual mode – in this mode of operation, the control system is overridden and the operator can operate the pump units manually via the pushbutton switches or Operator Interface Panels (Intelligent Starters) mounted on the door of the electrical assembly (Form 2) or motor starter compartments (Form 4).

3(R). The relays within the level control unit should be configured to achieve the following pump unit control philosophy based on four level set points (L1 to L4):

- a) Level rising through 'snore' level (L1) – no action;
- b) Level rising through duty/standby pump unit stop level (L2) – no action;
- c) Level rising through duty pump unit start level (L3) – start duty pump unit;
- d) Level falling through duty pump unit start level (L3) – no action;
- e) level falling through duty/standby pump unit stop level (L2) – stop duty pump unit if duty pump unit running or stop standby pump unit if standby pump unit running;
- f) Level falling through 'snore' level – inhibit both pump units (L1).

5. Consideration should also be given to the use of smaller pump units on the same guide rails as an interim measure. However consideration should be given to the design of the thermal overload protection.

D6.2 Hazardous areas

1(R). Parts of a sewage pumping station can be hazardous zones in accordance with the Dangerous Substances and Explosive Atmospheres Regulations 2002 (DSEAR). A risk assessment, taking into account any guidance from DCWW, should be carried out in accordance with DSEAR. This should be discussed with DCWW at an early stage in proceedings.

Undertaker Guidance:- The Risk assessment must be carried out referencing the guidelines included in the DCWW Pexa handbook, DCWW Explosion Protection Document (ref AM_FRM_051), and DCWW Procedural Document for Dangerous Substances and Explosive Atmospheres Regulations 2002 (DSEAR).

D6.3 Wet well - general

8. Typical general arrangements for Type 1, Type 2 and Type 3 wet well two pump pumping stations are shown on DCWW standard drawing no SDM4001/001, SDM4001/002 and SDM4001/003.

D6.4 Wet well – structural design

1. If the use of Polyethylene and Glass Reinforced Polymer GRP mouldings for package pumping stations applications is proposed prior approval from the Developer Services Team will be required.

6. If plastic moulding is considered, the moulding shall incorporate all necessary inlet and outlet nozzle connections, and preformed benching of the bottom section to prevent debris accumulating in dead zones. In addition, for increased depths and/or non standard site conditions, increased wall thicknesses shall be used in conjunction with the inclusion of external reinforcing ribs around the circumference of the PPS.

7. The base of the tank shall either be flat, or incorporate either stabilising feet or a circular base ring to enable the tank to be positioned on a RC slab at the bottom of the excavation. The pumping station shell moulding should incorporate an anti-flotation skirt to enable wet concrete, when poured around the station, to flow into the skirt as a mechanical key to offset the effects of buoyancy.

8. The requirements for the foundation slab and backfilling shall be as directed in the manufacturer's technical guidance literature. In locations subject to high water tables, the designer shall ensure that all necessary measures have been implemented to prevent flotation of the tank under all operating conditions. The uplift force can be considerable particularly if the water table reaches up to ground level. Anti flotation requirements and minimum GRP thickness should be calculated to ensure the pumping station can resist these forces.

9. The Contractor shall make provision for the wet well to be naturally vented directly to atmosphere and well away from any source of ignition.

D6.5 Valve chamber

1. The use of Polyethylene and Glass Reinforced Polymer GRP mouldings for valve chambers is acceptable if deemed more cost effective to concrete structures.

4. A penstock with an extension spindle to the underside of the cover for tee key operation can be used as an alternative.

6. Where it is impractical to have full opening covers then consideration shall be given to smaller access covers suitable for man access. However, consideration should be given to any headroom restrictions during, installation and maintenance of pipework and valves.

7. A typical valve chamber arrangement is shown on DCWW standard drawing no SDM4001/001, SDM4001/002 and SDM4001/003.

D6.6 Flow metering

1(R). For Type 3 and Type 4 pumping stations where the design flow of any pump unit is greater than 70 litres/second, a flow meter should be provided in the valve chamber or in a separate chamber to monitor discharge performance.

For Type 3 and Type 4 pumping stations where the design flow is less than 70 litres/second but located in a sensitive location such as bathing water area then a flow meter is required.

2c. where it is not practicable for a drain back to the wet well then the flow meter chamber shall have water tight cover.

D6.7 Access into wet well, valve chambers and flow meter chambers

1. Where man access is required openings should not be smaller than 900 mm x 900 mm. For specific installations larger opening may be required. The use of step irons is unacceptable and step rungs are preferred as a secondary means of egress.

2. i) (R) Covers and hinged safety grids should be positioned to give fall protection in the upright position where practical.

D6.10 Kiosk

1(R). The kiosk should, as a minimum, enclose the following equipment:

- a) The electrical assembly;
- b) The telemetry outstation;
- c) A kiosk heating and lighting system;
- d) A RCD switched 240 V socket.

- e) Cable containment trunking.

2. The Kiosk layout shall be set out as detailed in DCWW Standard Drawing D5 Kiosk SFA7 General Arrangement drawing number SD304-112.

D6.11 Kiosk construction

12(R). Statement removed.

13(R). In Type 3 pumping stations a small door or 'cat-flap' shall be fitted in the wall of the kiosk opposite the electrical assembly to provide access for standby generator facilities. The 'cat-flap' should be large enough to pass the standby generator cable and connector, and be horizontally hinged at the top. The 'cat-flap' should open outwards and be lockable in the closed position from inside the kiosk with internal shoot bolts.

14(R). The kiosk doors should be fitted with an Abloy manufactured key barrelled lock.

15. Where specified by the DCWW, the kiosk should meet the required security rating in accordance with the Loss Prevention Certification Board Standard 1175.

16(R). The following notices/information plates should, as a minimum, to be fitted to the kiosk:

- a) A notice giving instructions for resuscitation after electric shock to be fixed to the inside of a kiosk door;
- b) in Type 3 pumping stations where the facility has been included, a notice giving instructions for connection and use of a standby generator, including instructions for changing back to the mains supply following restoration of supply, to be fixed to the inside of a kiosk door;
- c) An information plate giving information relating to the pump units (serial/curve numbers, FLC, duty head and flow, etc.), the setting levels of the ultrasonic level Controller and the diameter and length of the rising main to be fixed, to the inside of a kiosk door;
- d) A complete set of wiring diagrams for the Electrical Assembly to be fixed to the inside of a kiosk door in a weatherproof envelope;
- e) A standard, black engraved on yellow 'DANGER – electrical apparatus (with flash symbol on a triangle) notice to be fixed to the exterior of a kiosk door. The highest voltage within the kiosk should be indicated in this label or adjacent. In Type 3 pumping stations, the notice should be manufactured from a durable plastic material and have dimensions of not less than 200 mm x 150 mm; and
- f) An information plate giving the name of the site, the Developer's contact name and emergency contact telephone number to be fixed to the exterior of a kiosk door. The notice should be manufactured from a durable plastic material and have dimensions of not less than 200 mm x 150 mm.

6 Part F – Mechanical and Electrical Specification for Small Pumping Stations

F1.1 Hazardous area appliances

1(R). All electrical and mechanical equipment selected for use in a hazardous area shall have undergone an appropriate conformity assessment procedure (CAP) to demonstrate compliance with the essential health and safety requirements of European Directive 94/9/EC (ATEX 95), as enacted in the UK by the Equipment and Protective Systems Intended for Use in Potentially

Explosive Atmospheres Regulations 1996 and the Equipment and Protective Systems (Amendment) Regulations 2001.

DCWW Guidance:- The Risk assessment must be carried out referencing the guidelines included in the DCWW Pexa handbook, DCWW Explosion Protection Document (ref AM_FRM_051), and DCWW Procedural Document for Dangerous Substances and Explosive Atmospheres Regulations 2002 (DSEAR).

F1.2 Operation and maintenance documentation

1. Three hard copies and one electronic copy are required.

F2.1 Introduction

1. To enable standardisation, it is preferred that the Developer use the relevant framework suppliers for pumps.

F2.3.6 Impellers

7. The pump will have impellers with suitable methods of attachment to shafts.

F2.3.14.1 General

4 (R). A proprietary lifting chain location system is not acceptable.

5 (R). Lifting chains shall be provided, permanently fixed within the wet well.

F2.3.14.2 Lifting Chain Location System

1 (R). A proprietary lifting chain location system is not acceptable.

F2.3.14.3 Lifting Chains

9. Submersible chains are examined in batches after removal from service. To enable this 5 year rotation, 20 % additional service chains shall be provided, i.e. where one to five similar chains are provided for the contract then a suitable spare chain shall be provided; if six chains are supplied then two suitable spares shall be provided etc. Every chain in the batch shall be capable of fulfilling the duty of the others.

10. All lifting Appliances shall be tested and supplied with an Individual Test Certificate (Certificate of Conformity), for each item of lifting equipment which shall include:

- The name of DCWW for the "Owner or Occupier";
- The serial number;
- The safe working load (SWL);
- DCWW Asset Number.

F2.3.16 Pump Unit Protection Sensors

3(R). Statement removed.

F3 ELECTRICAL

F3.1 Scope

1(R) This Addendum defines the requirements for the electrical equipment incorporated within the pumping station. This electrical equipment shall typically comprise:

- a) An incoming power supply;
- b) a low voltage switchgear and control gear assembly (hereafter termed the

- 'Electrical Assembly') incorporating the incomer, motor starters, control circuit supplies, common control equipment and interface for connection to the telemetry outstation, see clause F.3.3;
- c) The pumping station electrical installation, incorporating all electrical components, equipment and cabling outside the Electrical Assembly, and the pumping station Earthing and bonding system, see clause F.3.3;
 - d) instruments associated with the pumping station including the ultrasonic transducer head, float switches, and flow meter (if required), see clause F.3.5; and
 - e) A RTU remote telemetry unit with appropriate communications connection (for example, GSM, PSTN, radio link etc.), see clause F.3.6.
 - f) The Form 2 assembly general arrangement shall be followed as detailed in DCWW Standard Drawing SD304-111

F3.2.1 General

9. To enable standardisation by DCWW the developer's switchgear and control-gear assemblies shall be constructed in compliance with the DCWW Standard drawings no SD365, 366, 367, 368, 369 & 370.

10. To enable standardization by DCWW the developer shall select all switchgear and control-gear's low voltage components from the nominated DCWW Framework component supplier.

F3.3.1 General

2(R). The form of separation of the Electrical Assembly shall be Form 2a or 2b for type 1 and type 2 pumping stations, subject to the results of an approved risk assessment, which considers the need for a pump to continue running while work is carried out on the panel. This shall take into account factors such as, the volume of flow, the practicality of dealing with this flow by other means when the pumping station is not operational, the location of the pumping station location and the consequences of the risk of flooding or pollution occurring if the pumping station is not operational. For type 3 pumping stations where there is sufficient storage (as detailed in sections D4.5 & D4.6) then a Form 2a or 2b Electrical Assembly is acceptable, otherwise a Form 4 Electrical Assembly shall be required. For type 4 pumping stations the Electrical Assembly shall be Form 4.

F3.3.4 Earthing and Bonding

F.3.3.4.1 General

5. Statement removed.

F3.3.5 Cabling and Wiring

F.3.3.5.1 General

1(R) Power circuit wiring shall be 600 volt grade multi stranded copper tri-rated switchgear cable to BS 6231 or equivalent. Cable size shall be 1.0 mm² minimum. Control circuit wiring (including ICA/PLC wiring) shall be multi stranded copper tri-rated switchgear cable to BS 6231 or equivalent and multicore wiring shall comply with BS 6500 or equivalent. Minimum cable size shall be 1.0 mm² for motor starter control circuit wiring, and 0.5 mm² for ICA/PLC wiring.

Inter-compartment wiring shall comply with the clause above but may also utilise multicore PVC multi-stranded copper wire to BS 6500 or equivalent. Cable cores shall be sleeved to achieve the required colour coding.

2(R) Analogue signal cabling shall comprise screened cables (individually and/or collectively screened) and/or twisted pairs. Cable to BS5308 (Parts 1 &2) Specification.

F.3.3.5.2 Installation

4(R) Suitable segregation between cables serving different circuit categories (e.g. intrinsic circuits, and circuits protected by lightning and surge protection) shall be provided for at all times.

F.3.3.5.3 Identification of Wiring

1(R) All wiring except for Brown, Black, Grey phases shall be identified at both ends in accordance with schematic diagrams. Each wire shall be identically marked at each end, with the first character nearest to the termination end of the wire. The wire marking system employed shall be one of a proprietary pre-printed insulated sleeve type.

2(R) Wiring shall be terminated using crimped pin extensions, bootlace ferrules, or lugs of the correct size which crimp the insulation and the conductors. The number of every wire associated with circuits entering or leaving a compartment shall be prefixed by the compartment reference.

F.3.3.5.4 Termination of Wiring

F.3.3.5.4.1 General

1(R) The crimps shall be applied by means of a ratchet style crimping tool using the correct size of die. Where equipment is fitted with flat headed screw terminals, wire ends shall be fitted with crimped spades. Compression type terminals shall not be used, but where equipment (e.g. contactors) are complete with cage type terminals are then direct conductor termination shall be permitted.

2(R) All internal wiring shall be terminated at both ends (including spare cores).

3(R) Sufficient slack shall be provided within each cable terminated to allow for at least one re-termination.

4(R) Terminal mounts shall be suitable for the CSA of the wiring terminated.

5(R) Unless otherwise agreed, all terminals shall be arranged in single layer (i.e. no "piggy-back" terminals).

6(R) All circuit terminal rails shall include 10 % spare space, as built and commissioned.

7(R) Wiring shall be terminated using crimped cable ends, lugs or any other approved method that is suitable for the conductor and type of termination.

8 (R) Only the crimp/lug (or equivalent) manufacturer's recommended tools and equipment shall be used to perform the termination. All of the strands forming the conductor shall be connected at the point of termination.

9. Wiring shall be terminated so that all internal wiring is connected to one side of a terminal rail and all external cabling and wiring is connected to the other side of the same terminal rail.

10. Screw type terminals shall be used. Compression type terminals shall not be used, however where cage type terminals are present on equipment (e.g. contactors), then they shall be permitted.

11. Only one conductor shall be connected to a termination point. Where this is not reasonably practicable, then no more than two conductors shall be connected to one side of a terminal.

12. Sufficient, suitably sized earth terminals and end stops shall be provided.

13. Where a means of circuit disconnection is specified by the particular specification, suitable hinged link type terminals shall be provided where circuit disconnection is required (e.g. for analogue signal circuits, the isolation of external control devices and for all alarm and telemetry circuits). Hinged-link type terminals shall not be used for the isolation of power circuits.

14. Unless otherwise specified in the particular specification, fused terminals shall be provided for circuits feeding solenoid valves.

15. Terminals shall be grouped in a logical manner, with suitable segregation for terminals operating at different voltages. Where the I/O from a modular device such as a PLC is wired down to terminals the terminals shall be grouped in a similar order to the I/O module.

16. Proprietary shorting bars or combs shall be utilised where it is necessary to common terminals. Where practicable, cable trunking shall be positioned a minimum of 30 mm from any terminal.

17. Terminals shall be safely and easily accessible after all wiring has been installed and terminated.

18. Terminals shall face the compartment door for ease of connection.

19. Terminals shall be positioned and identified in accordance with the schematic diagrams for the Assembly.

20. Horizontal terminals shall be numbered left to right and vertical terminals top to bottom.

21. Where practicable, for incoming mains facilities a minimum distance of 300 mm shall be provided between the glandplate and terminals.
22. Groups of terminals shall be secured with an end stop at either end, which may be an earth terminal.
23. For incomers and large feeder compartments, where the cable is glanded within the compartment, the layout of terminals shall comply with BS 5372, and unless agreed otherwise with the Purchaser, where more than one multi-core power cable enters an incomer compartment, a further 500 mm (minimum), in addition to the 300 mm above, shall be provided between the gland plate and the terminals of the associated protective device.
24. To facilitate the termination of cable cores, a minimum distance of 100 mm shall be provided between the entry point of cables into a compartment and the associated terminals; this shall be increased, as required, for larger cables.
25. Where practicable, a minimum distance of 30 mm shall be provided between the exit point of wiring from trunking and the associated terminals.
26. Terminals used for the connection of intrinsically safe circuits shall be coloured blue and be physically separated from other terminal groups by a minimum distance of 50 mm. These terminals shall have a clear shrouded cover and be fitted with an appropriate warning label.
27. If practicable or recommended by the device manufacturer, screened signal cables shall be wired directly to and terminated at the device. If this is not practicable, the method of interface termination shall not compromise the integrity of either the conductors or screen.
28. Screened signal cables shall have the screen solidly connected to earth at the instrument end. To comply with EMC requirements, it may also be necessary to connect the screen to earth at the non-instrument end. If this is the case and such a connection will not compromise safety or performance, the screen shall be solidly connected to earth at the non-instrument end. If this is the case and such a connection will compromise safety or performance, the screen shall be capacitive coupled to earth at the non-instrument end.
29. If it is necessary to connect the screen to earth, either directly or via a capacitive coupling, a proprietary 360° connection shall be used.
30. If it is necessary to isolate the screen from earth a suitable length of the overall sheath and the screen shall be removed and a 30 mm long silicone rubber over-sleeve installed over the point of separation of conductors, screen and overall sheath.
31. Terminals of 16mm and above shall be of "bolted type".
32. The colour code for terminations shall be in accordance with Table 2 below.

| Table 2 – Colour Coding for Terminations Function | Colour |
|--|-------------------------|
| Protective Conductor | Green and Yellow |
| Phase conductors | Beige or Grey |
| Neutral | Beige or Grey |
| Power > 50 V | Beige or Grey |
| Control > 50 V | Beige or Grey |
| Control < 50 V | White |
| Instrumentation Analogue | White |
| Intrinsic Safety Analogue and Digital | Blue |
| Intruder/Interlocks ≥ 110 V Telemetry | Orange Beige or Grey |

F3.3.6 Indicator Lamps, Push-Buttons and Selector Switches

3(R). Statement Removed.

4(R). Table for Colour Coding for Pushbuttons

| Colour | Function |
|--------------------------|------------------------|
| Black | Stop/Off, Close |
| White | Start/Run, Reset, Open |
| Red on Yellow Background | Emergency Stop |

F3.3.7 Connection for a Mobile Generator

1(R). For type 3 pumping stations that have been risk assessed as requiring a connection for a mobile generator then a facility shall be provided.

3. Mobile generator appliance inlet (incomers up to and including 125 Amps) this shall be a 5 pole (L1, L2, L3 +N+E) male appliance socket to BS EN60309-2;

4. Mobile generator connection box (incomers up to and including 125 Amps).

5. Where a mains/generator changeover incoming section is specified, an in-line isolation device shall be provided for the generator supply. This may be accomplished by the use of an appliance inlet socket and plug fitted at the control panel/MCC.

6. Mains/generator manual changeover switches that have the termination of the mains supply in the same vertical plane as the generator supply are not to be used.

7. A second phase failure relay shall be supplied on the DNO live side as well as the load side to indicate via telemetry when DNO mains is restored where the load side relay will indicate generator mains failed supply.

F3.3.8 Abnormal Operation

F.3.3.8.2 Pump unit Failure (Initiated by Hard-Wired Pump unit Protection Systems)

1(R). The control system shall incorporate the following hard-wired pump unit protection systems:

- a) Motor overload protection;
- b) Pump stator over-temperature protection (Klixon switch);
- c) Pump unit mechanical seal failure protection (if the pump unit is rated at or above 7.5 kW);
- d) Motor under load protection (to detect ragging up/soft blockages, operation at levels below L1 (i.e. drawing in air) ;
- e) Low flow protection (if the pump unit is installed in a type 3 pumping station that has been risk assessed for requiring a flow meter);
- f) Statement removed two stage protection is not required on pumps rated less than 70kW.

6(R).Statement removed two stage protection is not required on pumps rated less than 70kW.

7(R).Statement removed two stage protection is not required on pumps rated less than 70kW.

8(R). When a remote reset signal and relay is installed and triggered from the telemetry unit, if the hard-wired protection systems detailed in clause 3.3.8.1a, above is activated, the control system shall allow the operator a maximum of three remote resets after which the drive shall be locked out.

Note: The Undertaker has the ability to include the limit on remote resets in their telemetry base station.

F.3.3.8.4 Back-Up Control Mode

1(R). The back-up control mode shall be configured as a control system operating independently of the ULC.

2(R). Upon receipt of a 'High Wet Well Level' signal from the back-up level control, the control system shall transmit a 'Back-up Control System Activated' alarm to telemetry.

F3.3.9 Telemetry Signals

1(R). When in accordance with 3.6, a telemetry outstation is to be provided by the undertaker, terminal blocks shall be provided in the Electrical Assembly for interfacing the pumping station and each pump unit with the telemetry outstation. The function of each terminal shall be as specified in Tables F.3 to F.6.

Table F.3 Telemetry requirements for pumping station monitoring

Table F.3 Telemetry requirements for pumping station monitoring

| Function | State Description | Signal Type | Terminal Numbers | Type 1 | Type 2 | Type3 |
|---|--------------------|----------------|------------------------|--------|--------|--------|
| Site mains (DNO) power health | Normal / Failed | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| High wet well alarm (F.3.3.8.4) | Normal / High | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| High wet well alarm (F.3.3.8.4) | Normal / High | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Back-up control system activated (F.3.3.8.4) | Normal / Activated | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Maintenance in progress | Off / On | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Level Controller health (F.3.3.8.3) | Normal / Failed | Digital Input | Refer to DCWW drawings | X | X | ✓ |
| Flow meter health | Normal / Failed | Digital Input | Refer to DCWW drawings | X | X | ✓ |
| Emergency overflow operating (Note 1) | Normal / Overflow | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Wet well effluent level | | Analogue input | Refer to DCWW drawings | X | X | ✓ |
| Pumping Station overload (Pump unit running & high level reached) | | Digital Input | Refer to DCWW drawings | X | X | X |
| Rising main delivery flow (totalised) | | Pulsed Input | Refer to DCWW drawings | X | X | Note 2 |
| Rising main delivery pressure | | Analogue input | Refer to DCWW drawings | X | X | X |

| | | | | | | |
|--|--|--------------|------------------------|---|---|--------|
| Power consumption | | Pulsed Input | Refer to DCWW drawings | X | X | Note 3 |
| <p>Note 1: Only required where there is an emergency overflow where this is provided on a replacement pumping stations.</p> <p>Note 2: Only required if the design flow rate of each pump unit is above 70 l/s.</p> <p>Note 3: Only required on Type 3 pumping stations if each pump unit is rated above 3.5kW utilising the intelligent starters VT module or where a power monitor unit is installed at the incomer.</p> | | | | | | |

| Table F.5 Telemetry requirements for the monitoring of each pump unit | | | | | | |
|--|--------------------------|--------------------|-------------------------|---------------|---------------|--------------|
| Function | State Description | Signal Type | Terminal Numbers | Type 1 | Type 2 | Type3 |
| Pump unit running | Running / stopped | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Pump unit tripped | Normal / tripped | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Pump unit available / not available | Available / unavailable | Digital Input | Refer to DCWW drawings | ✓ | ✓ | ✓ |
| Motor stator temperature | Normal / high | Digital Input | Refer to DCWW drawings | X | X | ✓ |
| Pump unit Vibration Caution (Note 1) | Normal / caution | Digital Input | Refer to DCWW drawings | X | X | X |
| Pump unit Vibration High (Note 1) | Normal / high | Digital Input | Refer to DCWW drawings | X | X | X |
| Pump unit Seal failure (moisture in pump) | Normal / failed | Digital Input | Refer to DCWW drawings | X | X | Note 3 |
| Pump unit lower bearing temperature | Normal / high | Digital Input | Refer to DCWW drawings | X | X | X |
| Pump unit load (for partial pump blockage) | Normal / under load | Digital Input | Refer to DCWW | X | X | Note 2&4 |

| | | | | | | |
|--|--|--|----------|--|--|--|
| | | | drawings | | | |
| <p>Note 1: Statement removed.</p> <p>Note 2: Only required if each pump unit rated at or above 22kW</p> <p>Note 3: Only required if each pump unit rated at or above 7.5kW</p> <p>Note 4: Will normally be required in all cases where the pump unit is in a hazardous zone in accordance with Dangerous Substances and Explosive Atmosphere Regulations.</p> <p>Note 5: On type 1&2 Pumping stations where there are insufficient Digital inputs available it is acceptable to complex Auto available and Pump Tripped signals.</p> | | | | | | |

8. DCWW has two alternative approved remote telemetry unit suppliers. It is recommended to contact the DCWW telemetry department for advice on the selection of the correct remote telemetry station supplier for the application.

F.3.3.11.1 General

4. DCWW has a preferred option when Form 4 Assemblies are required, to use intelligent field-bus (profibus) components. The field-bus communicates with the intelligent incomer compartment, intelligent starter compartments and intelligent common control compartment which houses a PLC & HMI. If the developer wishes to consider this option the DCWW ES304 specification and ES304 standard drawings are available on request to the DCWW Cost & Engineering Department.

F.3.3.11.2 Incomer Compartment

3e) It is accepted by DCWW that when the power monitoring is performed by a power monitor unit there would be no requirement for a panel mounted voltmeter and ammeter

F.3.3.11.3 Control Circuit Supplies

9. It is acceptable to DCWW for the CCTs not to have secondary earth screens on their secondary supplies and it is DCWW preference for the secondary supply to be 110 v AC and not 24 V AC.

F.3.3.11.4 Motor Starter Compartments

5(l) It is preferred if the common reset Push button can be incorporated in the Off position of the auto/off/hand selector switch on form four panels.

F.3.3.11.5 Common Control Compartment (CCC)

4(R). The design and construction of the CCC shall enable safe inspection, testing, calibration and diagnostic activities to be carried out with the CCC energised and accessible. Safe testing shall be afforded by the use of circuit supplied from the Control transformer at 110v AC & 24v DC voltage systems where segregation of circuits employing different voltages. Additional localised shrouding of circuits above extra-low voltage shall be provided to IP2X minimum.

F.3.3.12.2 Assembly Equipment

1. The Electrical Assembly shall, as a minimum, incorporate the following functional units:
 - a) Control circuit supplies;
 - b) a 'Pump unit No. 1' motor starter;

- c) a 'Pump unit No. 2' motor starter ; and
- d) a common control circuit; (R)

F.3.3.12.3 Incomer

6. It is DCWW preference to have the kiosk services distribution board mounted externally to the main incomer enclosure in a suitable location within the kiosk and the incomer to be fitted out with a fuse-fed, single phase and neutral, feeder to supply the Kiosk distribution board. The DCWW preference is to not fit voltmeters and ammeters to Type 1 & 2 stations but supplement with a 'mains healthy' lamp

F.3.3.12.4 Control Circuit Supplies

8. It is DCWW preference to not install screens to secondary voltages and have a preference to use 110v AC and not 24v AC on the secondary circuit of the CCT

F.3.3.12.5 Motor Starters

8. With respect to clause F.3.3.12.4.1e) above, DCWW motor starters on type 1 & 2 stations may incorporate only the following motor protection:

- a) Motor over-temperature protection;
- b) Pump unit mechanical seal failure protection (if the pump unit is rated at or above 7.5 kW);

F.3.3.12.6 Common Control Section

1.g) In many of the Type1 & 2 pumping stations it is not practicable to install ultrasonic controllers due to the dimensional size of the well. In such stations the level control shall be carried out by float switches. The float switches shall be installed at four levels

- HH
- Pump Start
- Pump Stop
- LL (snore)

Where an ultrasonic controller is supplied.

Emergency Pump back up control, shall be included when a HH float switch is installed

8. It is acceptable to DCWW to use 110v AC for control circuits as well as extra low voltages and but it is preferred to use individual termination block by voltage type or to fit raised separators between voltage bands or type when sharing the same terminal block.

F.3.4.1.5 Junction Boxes

7. It is DCWW preference to not install junction boxes internal to wet wells irrespective to DSEAR zone classification of the pumping station. If junction boxes are to be installed for cabling between the wet well and kiosk it shall be installed on suitable up stands or in a below ground junction box chamber external to the wet well in a rated suitably rated IP enclosure. Where the kiosk and wet well are located at a convenient distance apart the cabling shall be wired directly from the kiosk to the wet well in a continuous underground duct or ducts.

F3.4.3 Cables

Note 2:

| Type of Cable | Relevant Standard | Voltage Rating (V) |
|--|--------------------------|--------------------|
| XLPE/PVC (single core) | BS 7889 | 600/1000 |
| XLPE/AWA/PVC and XLPE/SWA/PVC1 | BS 5467 | 600/1000 |
| PVC/PVC | BS 6346 | 600/1000 |
| PVC/AWA/PVC and PVC/SWA/PVC1 | BS 6346 | 600/1000 |
| Single core PVC2,3 | BS 6004 (Table 1) | 450/750 |
| Flat twin and earth PVC | BS 6004 (Table 5) | 300/500 |
| Flexible PVC/PVC4 | BS 6500 (Table 26 or 28) | 300/500 |
| Flexible PVC/PVC5 | BS 7919 (Table 40 or 41) | 300/500 |
| Armoured, heat and oil resisting and flame retardant (formally designated HOFR)1,6 | BS 6883 | 600/1000 |
| Flexible, heat and oil resisting and flame retardant (formally designated HOFR) | BS 7919 (Table 16 or 17) | 450/750 |
| XLPE/LSF7 | BS 7211 | 450/750 |
| XLPE/AWA/LSF and XLPE/SWA/LSF1,7 | BS 6724 | 450/750 |
| XLPE/LSF7,8,9 | BS 7629 | 300/500 |
| XLPE/AWA/LSF and XLPE/SWA/LSF1,7,8 | BS 7846 | 600/1000 |
| SY/CY | BS 6500 | 300/500 |
| SY | BS 7211 | 300/500 |

NOTES:

- Aluminium wire armoured shall be used to reduce the magnitude of induced voltages and currents.
- The insulation shall be phase coloured and, if used in single-phase systems. Line cables shall be brown and neutral cables blue.
- Only to be used within conduit or trunking.
- Only to be used in offices and similar buildings.
- For industrial environment use.
- This type of cable shall comply with BS 6883, Section 3 (insulation type GP4 (BS 7655-1, Section 1.2); sheathing type A/RS3 (BS 7655-2, Section 2.3).
- Only to be used in public areas and in areas where there is significant risk of harm to persons or equipment in the event of a fire involving cabling.
- These cables shall be used if there is a specific requirement to maintain circuit integrity under fire conditions in accordance with BS 6387 and BS 7346-6 (e.g. gas detection systems, fire detection/alarm/fighting systems, protected lighting circuits, emergency lighting systems).
- This cable is not to be buried directly in the ground or in the fabric of the building.

Cable Outer Sheath Colours

| Cable Application | Colour |
|---|--------------|
| Protective Conductors | Green/Yellow |
| Intrinsically safe cables | Light Blue |
| Profibus DP cables | Purple |
| Profibus PA cables | Blue |
| Ethernet cables | Green |
| Fire detection/alarm/fighting system cables | Red |
| Emergency lighting and Gas Detection cables | Black |
| Security system cables | Grey |

Signal & Instrument Cables

Unless specified in the particular specification, signal and instrument cables shall have stranded copper conductors and comply with BS 5308 Part 2 and of Types 1 and 2.
All multi-pair signal and instrument cables shall have as a minimum number of spare pairs as follows:
Cables above and including 5 pair shall have 20 % spare cores.

A minimum of 2 pair cable shall be installed (note: 1 pair cable is not acceptable).

F3.4.4 Installation of Cables

5.g) IA single duct for each of the following is acceptable:

- DNO incomer including supplied earth
- Pumps power cabling between Kiosk and wet well
- Pump protection, float switches or/and ultrasonic controller between kiosk and wet well.

15. Polyurethane foam may Only be use to seal the kiosk duct after the wet well has been risk assessed and declared as un-zoned as agreed by DCWW DSEAR committee.

F.3.4.5.1 Glanding

5. It is DCWW preference when a cable is glanded through a painted or otherwise coated metallic surface, earth continuity is electrically tested and recorded between the gland and the enclosure.



F3.5.1 Flowmeter Specification

1. For Type 2 & 3 pumping stations where the design flow is less than 70 litres/second but located in a sensitive location such as bathing water area or a sensitive water course then a risk assessment shall be carried out to decide should a flow meter be included.

F3.6 Telemetry outstation

1.c) DCWW have an approved Telemetry outstation manufacturer (Seprol 250). It is recommended to contact the DCWW telemetry department for advice on the selection of the correct telemetry station supplier for the application.

NOTES FIELD CONNECTIONS



To Schematic 2
P1 KLIXON

To Schematic 3
P2 KLIXON

TO TELEMETRY OUTSTATION
PFR1-1
Mains Failed

| REV | REVISION | ENR | CHK | REQD | DATE |
|-----|--------------|-----|-----|------|------------|
| 1 | ISSUE STATUS | | | | 29.11.2012 |




DCWW STANDARD DRAWINGS
PART OF SPECIFICATION MS107

PROJECT:

PROPOSED DRAWINGS

TITLE:
FORM 2 PANEL
SFA7 SCHEMATIC 1

| INITIALS | | DATE | | SCALES | |
|---------------------------|----|------|------------|-----------|--------|
| DRW | BR | TD | 29.11.2012 | | N/S |
| CHECKED | BY | CJ | 29.11.2012 | | |
| REVIEWED | BY | RD | 29.11.2012 | | |
| DIMENSIONS IN MILLIMETRES | | | | A1 | |
| CLIENT DRAWING NO. | | | | SD302-365 | REV. 1 |

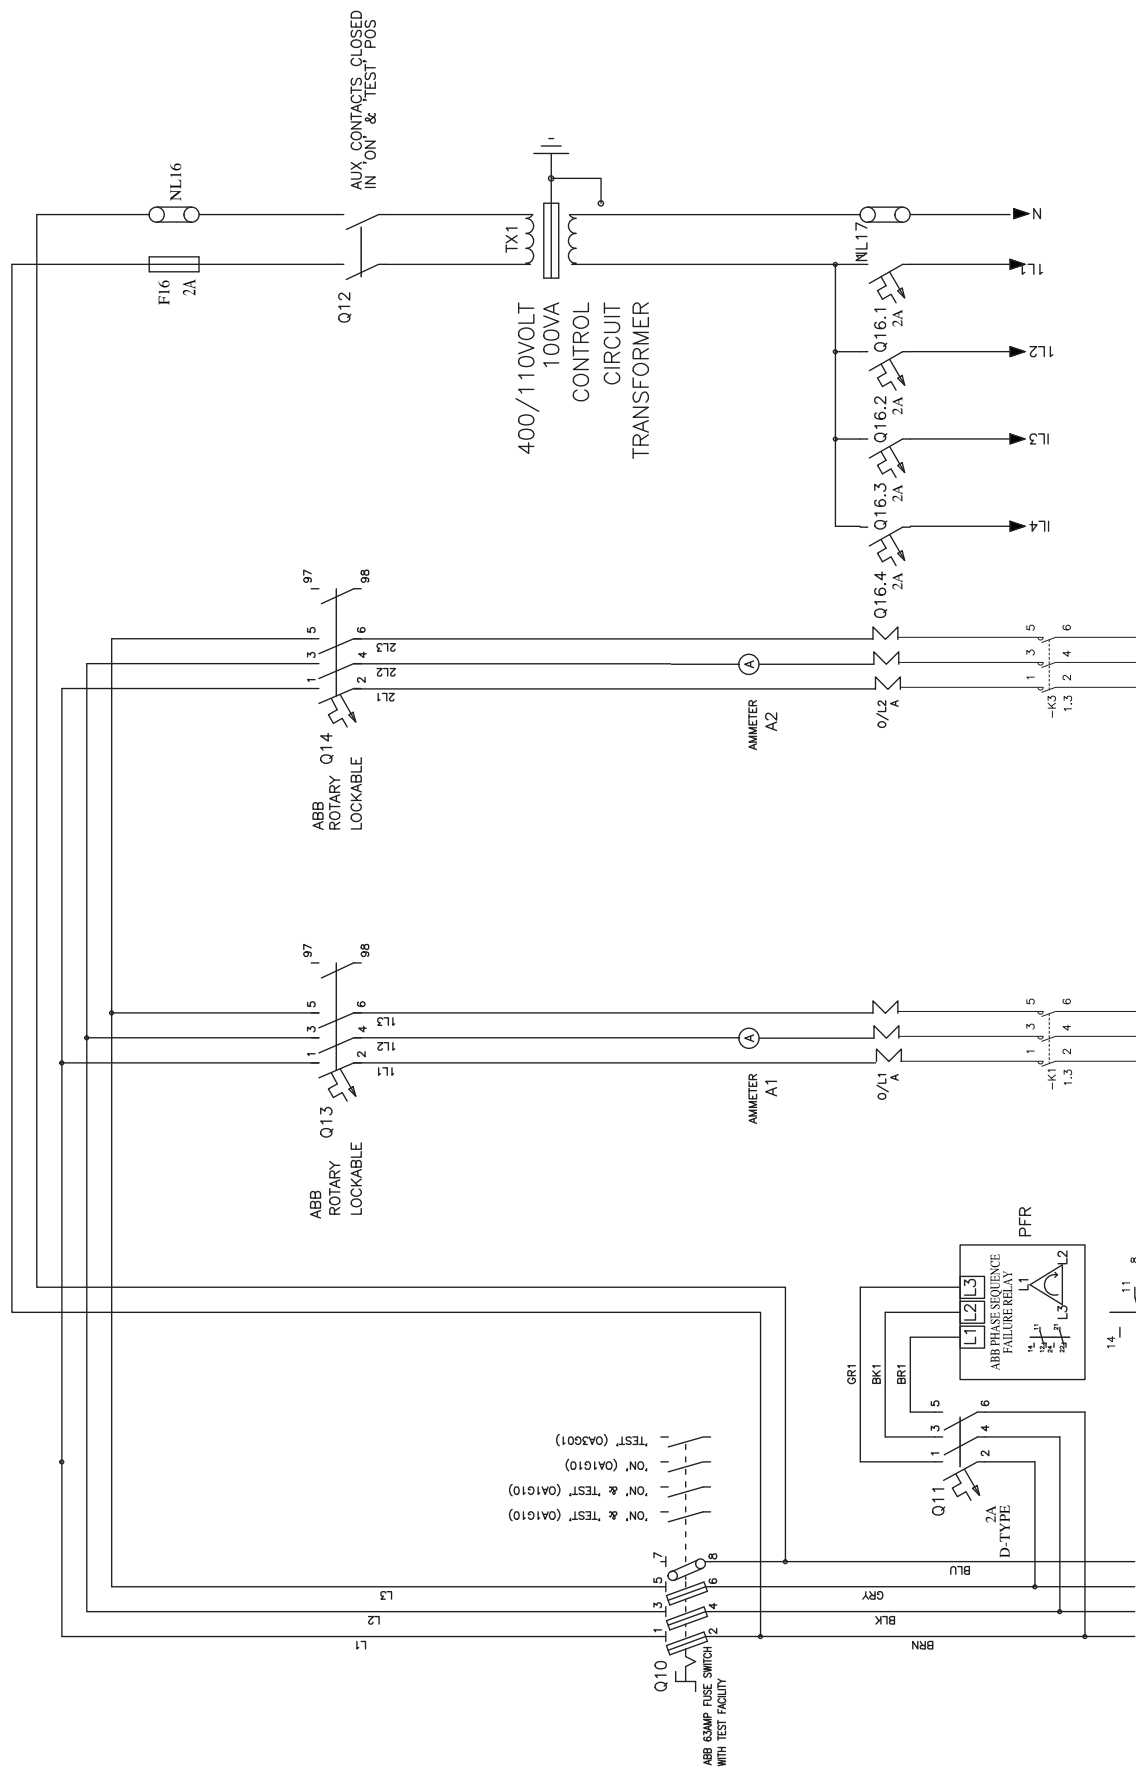

ALL LV COMPONENTS MANUFACTURED BY ABB
AND SELECTED FROM THE DCWW FRAMEWORK
LOW VOLTAGE COMPONENT MANUAL

400V +N & PE SUPPLY
MAIN IN-COME





MOTOR No.1 TERMINALS
(SEE FIELD CONNECTIONS)

MOTOR No.2 TERMINALS
(SEE FIELD CONNECTIONS)

DRAFT FOR INFORMATION
DRAWN BY: DATE: 29.11.12

PART NUMBER
1 SVR 630 885 R3300

NOTES
TO TELEMETRY OUTSTATION COMPARTMENT




DCWW STANDARD DRAWINGS
PART OF SPECIFICATION MS107

PROJECT: PROPOSED DRAWINGS


TITLE: FORM 2 PANEL
SFA7 SCHEMATIC 2

| INITIALS | | DATE | | SCALES | |
|---------------------------|-----------|------------|--|--------|-----|
| DRAWN BY: | TD | 28.11.2012 | | | |
| CHECKED BY: | CU | 28.11.2012 | | | N/S |
| REVIEWED BY: | RD | 28.11.2012 | | | |
| DIMENSIONS IN MILLIMETRES | | | | | |
| CUSTOMER DRAWING NO. | | | | | A1 |
| REV. | SD302-366 | | | | 1 |

110Vac SUPPLY FROM Q16.2 (SHT. No.1)

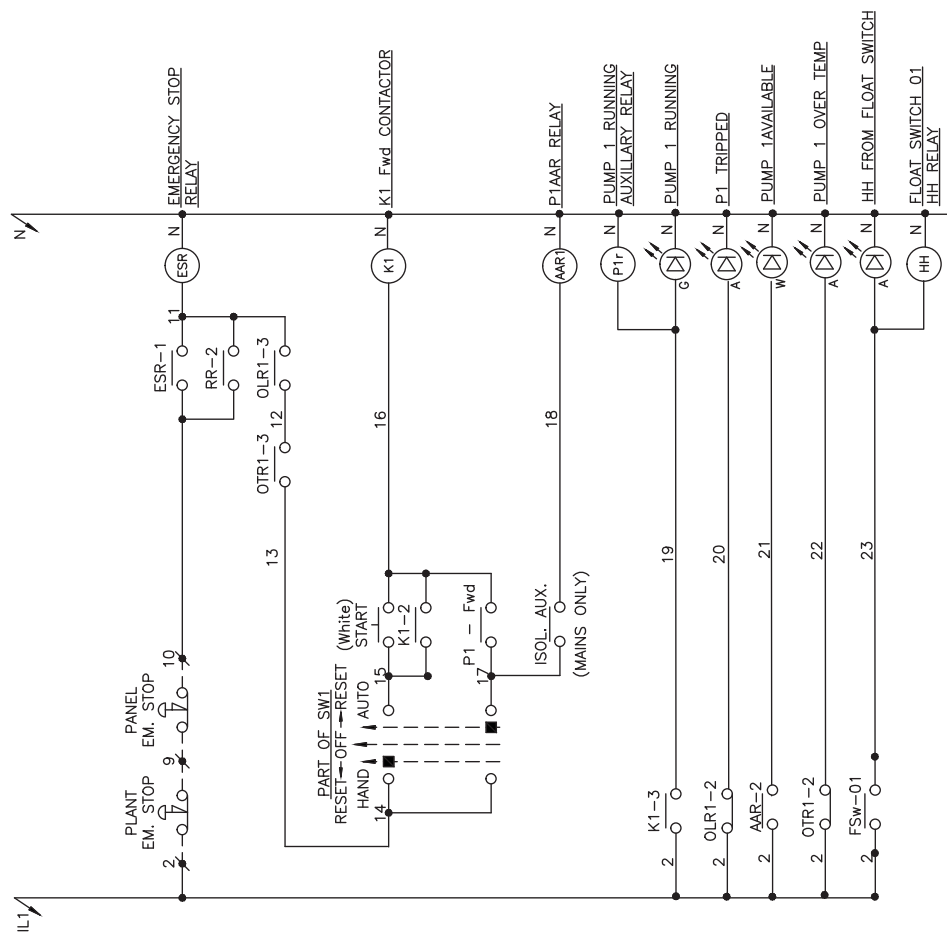

110Vac SUPPLY FROM Q16.2 (SHT. No.1)

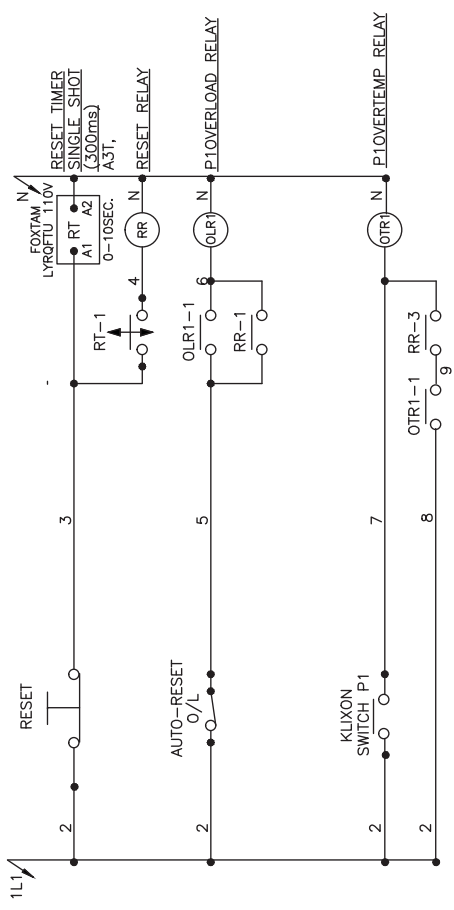

DRAFT FOR INFORMATION
DRAWING ID: DATE: 28.11.12

NOTES

TO TELEMETRY OUTSTATION ENCLOSURE

P2r-1 Comm
 P2Running
 OLR2-3 OTR2-3
 AAR2-3
 P3 Available

TO SCHEMATIC 4

OLR2-4 OTR2-4 Comm
 AAR2-4 P1 FAILED/UNAVAILABLE

From Schem 4 Signals

U/S
 P2R-1
 17 PUMP 2 RUN
 19 PUMP 2 RUN

| REV | REASON | DRN | CHK | RECD | DATE |
|-----|--------------|-----|-----|------|------------|
| 1 | ISSUE STATUS | | | | 28.11.2012 |



DCWW STANDARD DRAWINGS
PART OF SPECIFICATION MS107

PROJECT:


PROPOSED DRAWINGS

TITLE:
FORM 2 PANEL
SFA7 SCHEMATIC 3

| INITIALS | | DATE | | SCALES | |
|---------------------------|----|------------|--|--------|-----|
| DRAWN BY: | TD | 28.11.2012 | | | |
| CHECKED BY: | CJ | 28.11.2012 | | | N/S |
| REVIEWED BY: | RD | 28.11.2012 | | | |
| DIMENSIONS IN MILLIMETRES | | | | | |
| CLIENT DRAWING NO. | | | | A1 | |
| SD302-367 | | | | REV. | 1 |

110Vac SUPPLY FROM Q16.2 (SHT. No.1)

110Vac SUPPLY FROM Q16.2 (SHT. No.1)

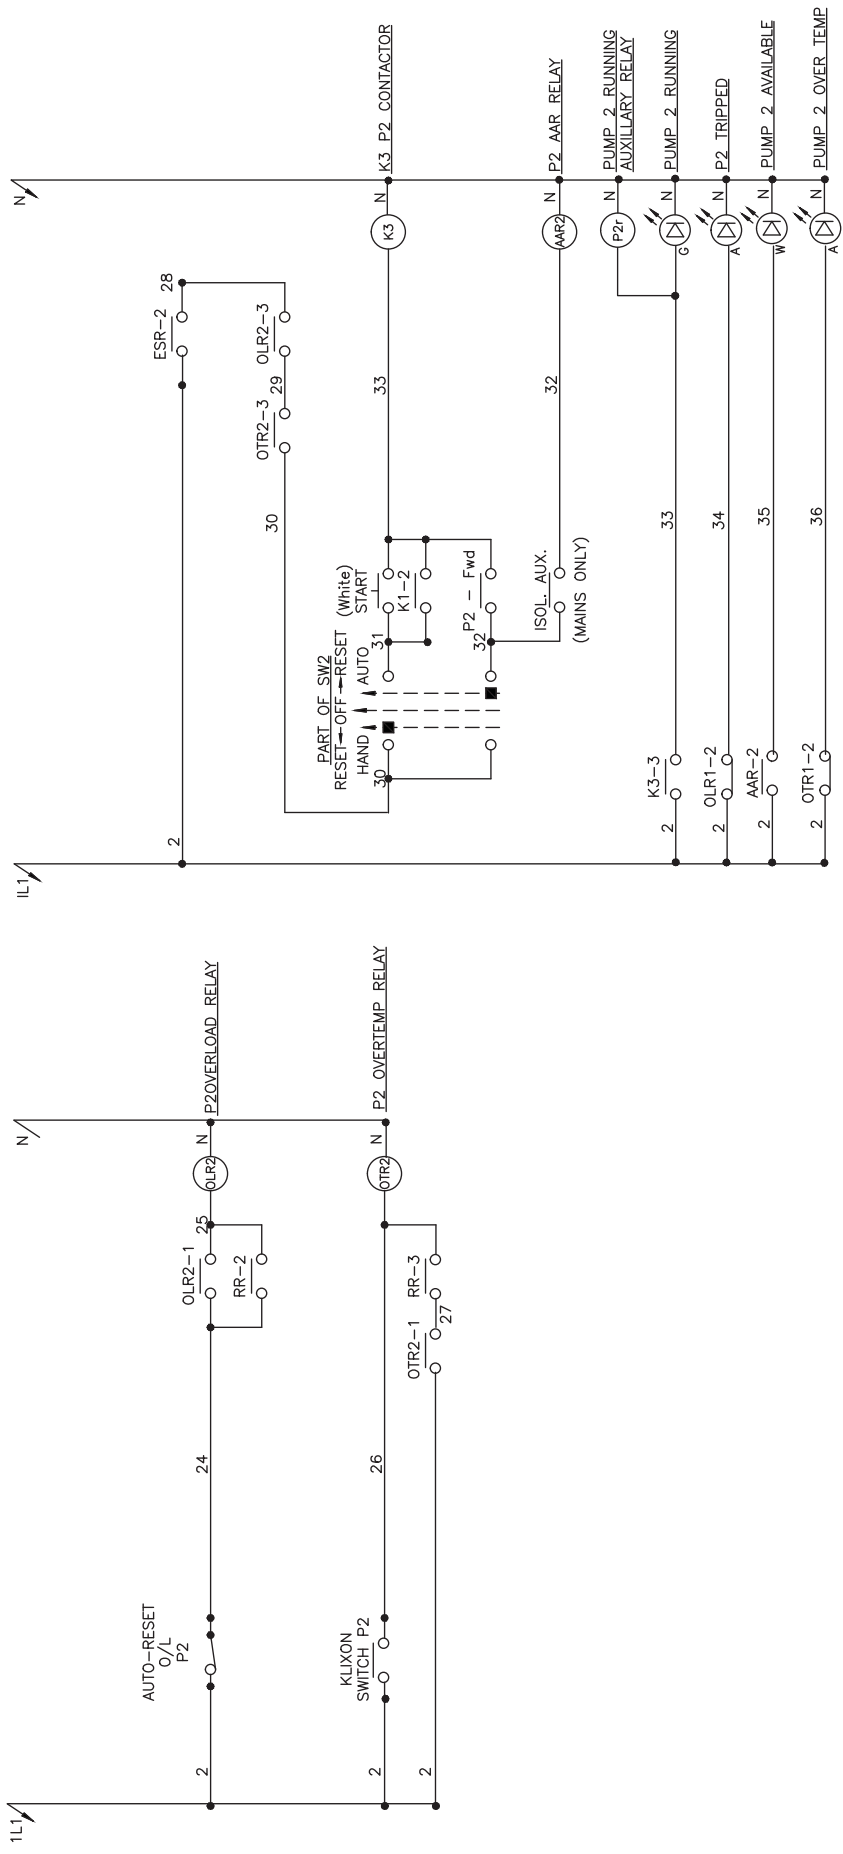

DRAFT FOR INFORMATION
DRAWING ID: DATE: 28.11.12

NOTES


Control signals TO Schematic 2



Control signals FROM Schematic 2



TO TELEMETRY OUTSTATION ENCLOSURE

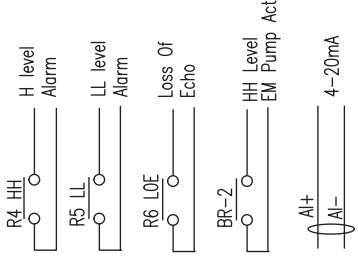

| REV | REASON | DRN | CHK | RECD | DATE |
|-----|--------------|-----|-----|------|------------|
| 1 | ISSUE STATUS | | | | 28.11.2012 |




DCWW STANDARD DRAWINGS
PART OF SPECIFICATION MS107

PROJECT: PROPOSED DRAWINGS

TITLE: FORM 2 PANEL
SFA7 SCHEMATIC 4

| INITIALS | | DATE | | SCALES | |
|------------------------------|----|------------|--|--------|-----|
| DRAWN BY: | TD | 28.11.2012 | | | |
| CHECKED BY: | CJ | 28.11.2012 | | | N/S |
| REVIEWED BY: | RD | 28.11.2012 | | | |
| DIMENSIONS IN MILLIMETRES | | | | | |
| CLIENT DRAWING NO. SD302-368 | | | | REV. | 1 |

IS BARRIER DE- ENERGISES WHEN FLOAT SWITCH BREAKS AT HIGH LEVEL SIMULTANEOUSLY DE ENERGISING TIMER T2 AND RELAY BR STARTING PUMP 1 IF AUTO AVAILABLE WHEN PUMP1 RUNS THE WET WELL LEVEL FALLS MAKING THE FLOAT SWITCH RE ENERGISES TIMER T2 EXPIRES AFTER PUMP DOWN PERIOD STOPPING DUTY PUMP

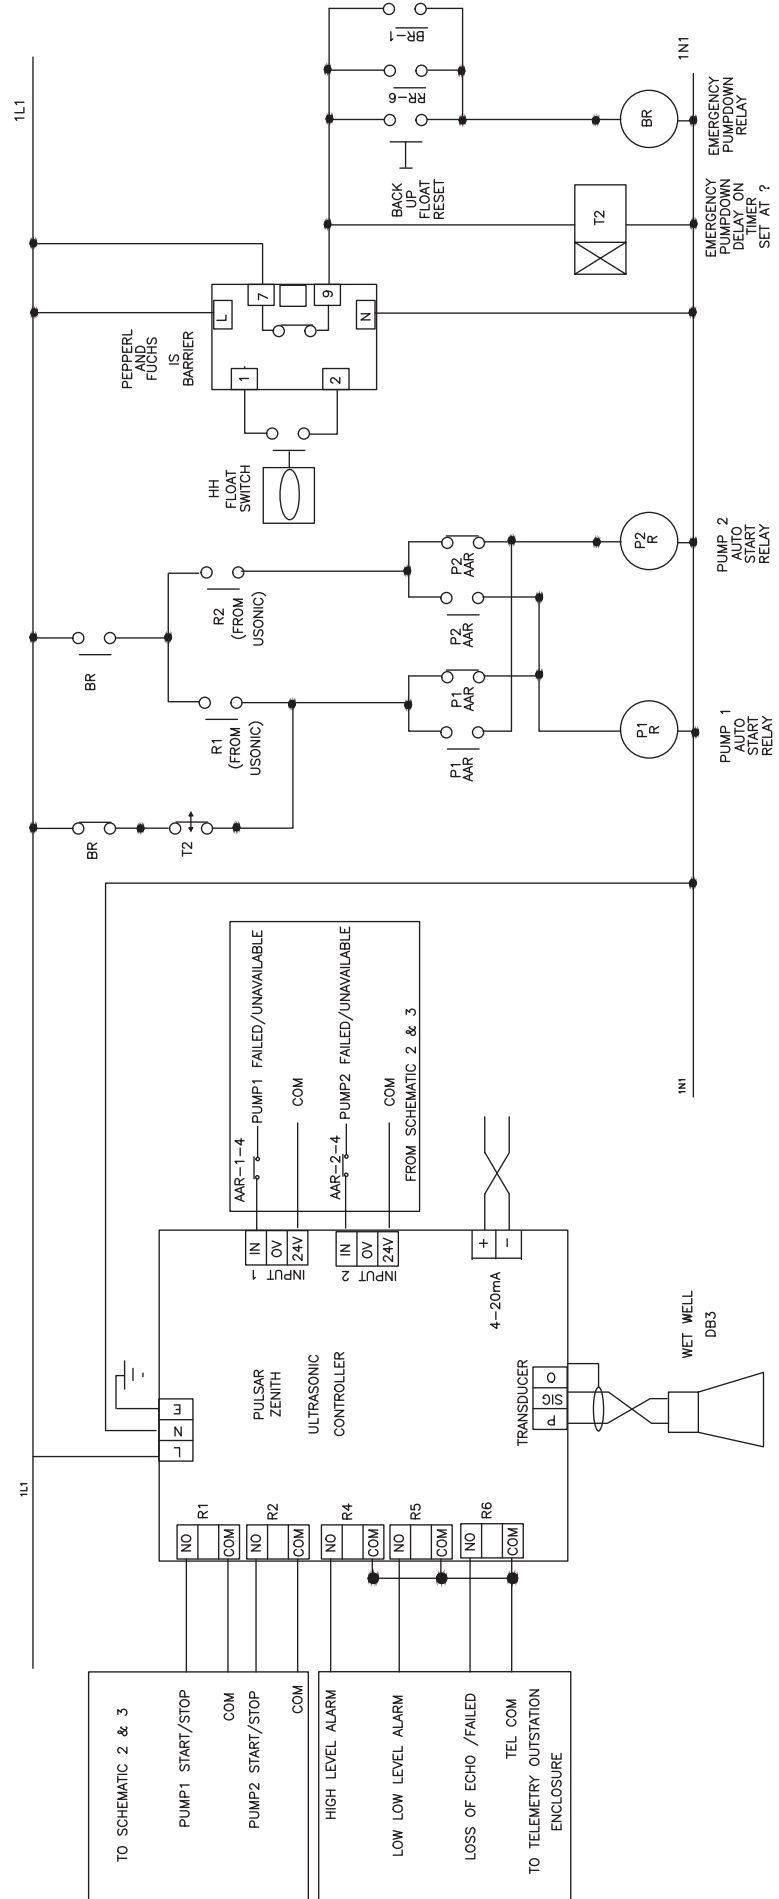

TO SCHEMATIC 2 & 3

PUMP1 START/STOP COM

PUMP2 START/STOP COM

HIGH LEVEL ALARM

LOW LOW LEVEL ALARM

LOSS OF ECHO /FAILED TEL COM



TO TELEMETRY OUTSTATION ENCLOSURE

DRAFT FOR INFORMATION
DRAWN: TD DATE: 28.11.12

NOTES

- FROM SCHEMATIC 4
 - R4-1 High Level
 - R5-1 Low Low Level
 - R6-1 LDC/Failed
 - BR-2 Emergency Pumping Active
- TO SCHEMATIC 2
 - DO 1
 - r reset
 - TEL REMOTE RESET
- FROM SCHEMATIC 2
 - PIR-2 PUMP 1 RUNNING
 - OLR1-4 PUMP 1 AVAILABLE
 - OTR1-4
 - AR2-4 PUMP 2 AVAILABLE
- FROM SCHEMATIC 3
 - P2R-2 PUMP 2 RUNNING
 - OLR2-4
 - OTR2-4
 - ARZ-4
- FROM SCHEMATIC 1
 - PPR-1 MAINS SUPPLY FAILED
- FROM MAINS INCOMER COMPARTMENT
 - PPR-1 DNO SUPPLY FAILED
- FROM SCHEMATIC 4
 - 4-20mA WET WELL LEVEL

230Vac SUPPLY FROM KIOSK DISTRIBUTION BOARD

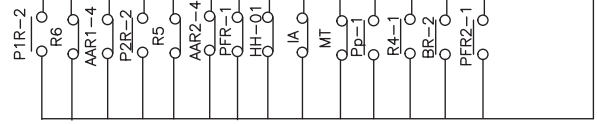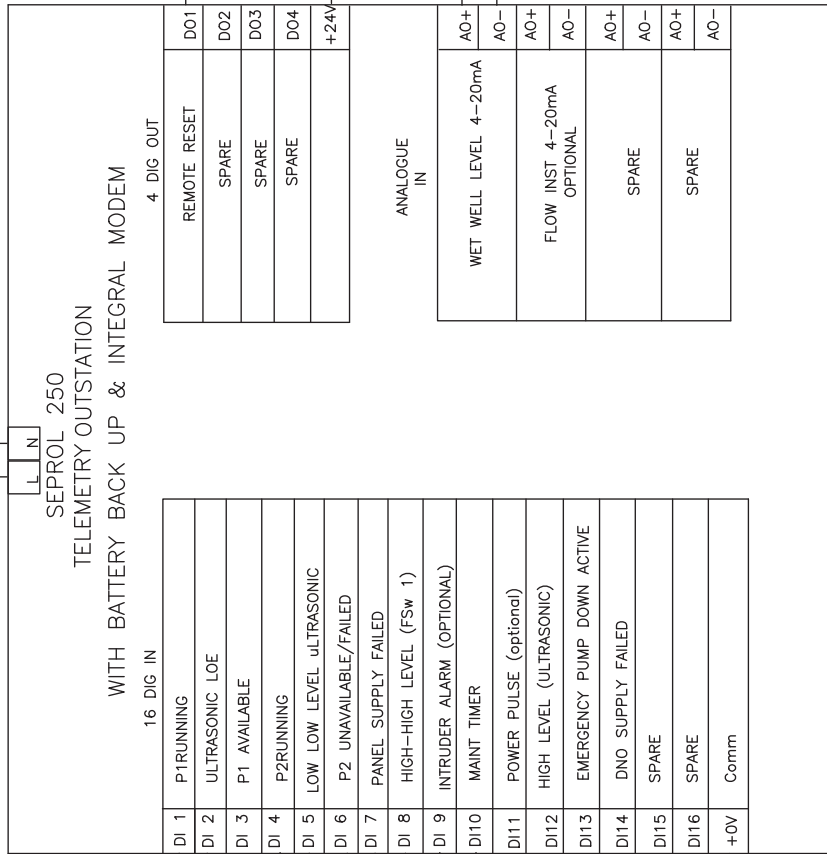

WET WELL
ULTRASONIC
SCHEMATIC
4



DCWW STANDARD DRAWINGS
PART OF SPECIFICATION MS107

PROJECT:

PROPOSED DRAWINGS

TITLE:
SFA7 TELEMETRY
S250 OUTSTATION ENCLOSURE

| INITIALS | | DATE | | SCALES | |
|------------------------------|----|------------|--|--------|--------|
| DRAWN BY: | TD | 28.11.2012 | | | |
| CHECKED BY: | CJ | 28.11.2012 | | | NTS |
| REVIEWED BY: | RD | 28.11.2012 | | | |
| DIMENSIONS IN MILLIMETRES | | | | | |
| CLIENT DRAWING NO. SD302-369 | | | | A1 | REV. 1 |

DRAFT FOR INFORMATION
DRAWN: TD DATE: 28.11.12

NOTES

1. FOR PART NUMBERS, SEE DRAWING SD002-360.

PANEL SPEC: FORM 2

| |
|--------------------------|
| PANEL TYPE: WALL MOUNTED |
| CABLE ENTRY: BOTTOM |
| PANEL EDIT: BOTTOM |
| ACCESS: FRONT |
| IP RATING: 54 |
| BACKPLATE COLOUR: WHITE |

| RATED VOLTAGE | VOLT | PHASE | HZ |
|-------------------|------|-------|----|
| OPERATING VOLTAGE | 400 | 3 | 50 |
| ANALOGY VOLTAGE 1 | 230 | 1 | 50 |
| ANALOGY VOLTAGE 2 | 110 | 1 | 50 |
| ANALOGY VOLTAGE 3 | 24 | 1 | 50 |
| ANALOGY VOLTAGE 4 | 24 | 1 | 50 |

PUSH BUTTONS

| | |
|----------------|--------------|
| EMERGENCY STOP | RED LATCHING |
| START | WHITE |
| RESET | WHITE |

CABLE COLOURS

| POWER | CONTROL |
|-----------|--------------------|
| L1: BROWN | BROWN (A) BLUE (N) |
| L2: BLACK | BLACK (C) BLUE (N) |
| L3: GREY | WHITE |
| N: BLUE | WHITE |
| | YELLOW |
| | RED |
| | ORANGE |
| | INDIGO |
| | US CIRCUITS |
| | LIGHT BLUE |

INDICATORS

| | |
|----------|-------|
| POWER ON | WHITE |
| STOPPED | WHITE |
| RUNNING | GREEN |
| FAULT | AMBER |

| REV | REASON | DRN | CHK | REQD | DATE |
|-----|--------|-----|-----|------|----------|
| 1 | DRAFT | | | | 26/09/12 |



DCWW STANDARD DRAWINGS
PART OF SPECIFICATION MS166

PROJECT:

TWO PUMP WASTEWATER
PUMPING STATIONS

TITLE:

FORM TWO PANEL
GENERAL ARRANGEMENT

| INITIALS | | DATE | | SCALES | |
|---------------------------|----|------------|--|-----------|-----|
| DRAWN BY: | TD | 26/09/2012 | | | |
| CHECKED BY: | CJ | 26/09/2012 | | | NTS |
| REVIEWED BY: | RD | 26/09/2012 | | | |
| DIMENSIONS IN MILLIMETRES | | | | A1 | |
| CLIENT DRAWING NO. | | | | SD304-111 | |
| REV. | | | | 1 | |

